


## Installation Instructions:

### Ducted

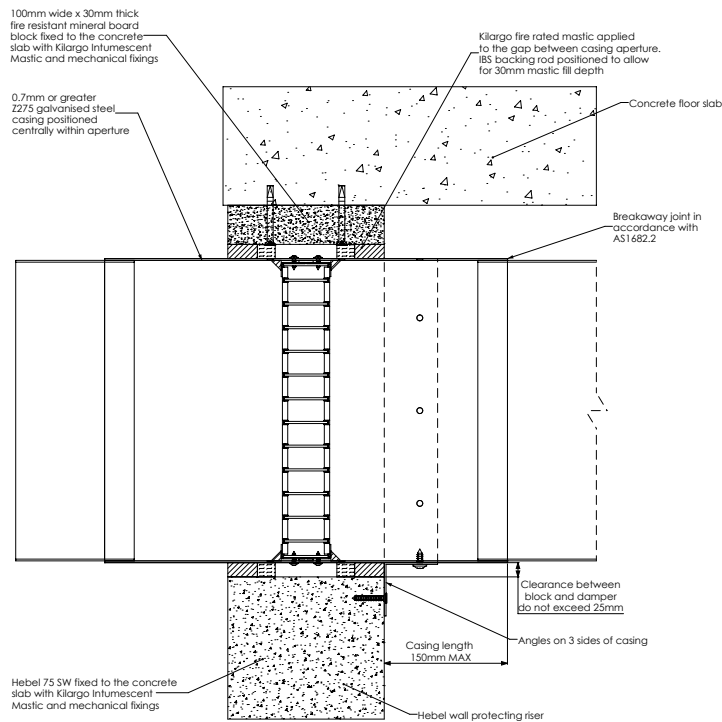

- Step 1** Measure and cut 100mm wide x 30mm thick fire-resistant mineral board packer (supplied by others) to match the damper width.
- Step 2** Mechanically fix 100mm wide x 30mm thick fire-resistant mineral board packer to concrete slab, with Kilargo Intumescent Mastic in between, and steel anchors as per system drawings.
- Step 3** Position damper centrally in penetration aperture as per system drawing with IBS Backing Rod and temporary supports or packers.
- Step 4** Apply Kilargo Intumescent Mastic (supplied separately) to the gaps between the damper & building element. Ensure fill depth corresponds with those detailed in the system drawing.
- Step 5** Fasten mounting angles to damper with steel self-drilling screws or steel pop rivets and, if detailed, to the building element with appropriate mechanical fixings as per system drawing.
- Step 6** Ensure product and certification labels are in a prominent position for easy identification during subsequent maintenance inspections.
- Step 7** Connect ductwork to the damper casing with AS 1682.2 compliant breakaway joint.

### System Notes

- Fire-resistant mineral board packer, IBS backing rod & fixings are to be supplied by others.
- Kilargo Intumescent Fire Dampers shall be installed in accordance with this detail, including the use of Kilargo Intumescent Mastic and in accordance with the requirements of AS1682.2.
- Ensure convenient access is provided for visual inspection and cleaning as necessary.
- 2mm Minimum gap allowable between damper and aperture. For gaps between 2-5mm, a fillet of Kilargo Intumescent Mastic shall be applied.

Building element:	Hebel
Application:	Mounted in casing tight to underside of slab with 30mm thick packer and angles on 3 sides of the IFD on 1 side of the wall
Maximum size:	300 x 300
FRL	-/120/-
Test reference No.	FAS200229
<b>System No.</b>	<b>WH7</b>