


Installation Instructions

Circular damper in Stainless Steel sleeve penetrating masonry wall

1. Position and centre the spigot containing fire damper in the penetration aperture as per System Drawing.
2. Fasten supplied mounting tabs to exterior of spigot with steel self drilling screws or steel pop rivets.
3. Fix mounting tabs to wall using masonry anchors (supplied by others).
4. Fire-stop any gaps between the damper & building element with Kilargo Intumescent Mastic (supplied separately). Ensure mastic fill depth corresponds with those detailed in the System Drawing.
5. If connecting ductwork to installed damper ensure that an appropriate AS1682.2 compliant breakaway joint method is used.
6. Ensure product and certification labels are in a prominent position for easy identification during subsequent maintenance inspections.
7. Ensure convenient access is provided for visual inspection and cleaning as necessary.

Notes

1. Product must be fitted in accordance with this detail, including the use of Kilargo Intumescent Mastic to ensure compliance with Kilargo Fire Test Approval detailed.
2. Fixing screws and anchors are to be supplied by others.

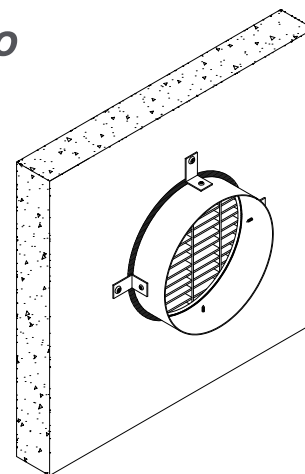

Building Element	Masonry
Application	Stainless steel sleeve in penetration
Maximum Size	350mm diameter
FRL	-/120/-
Test Reference No.	EWFA 22774/05

System No. **WM7**