
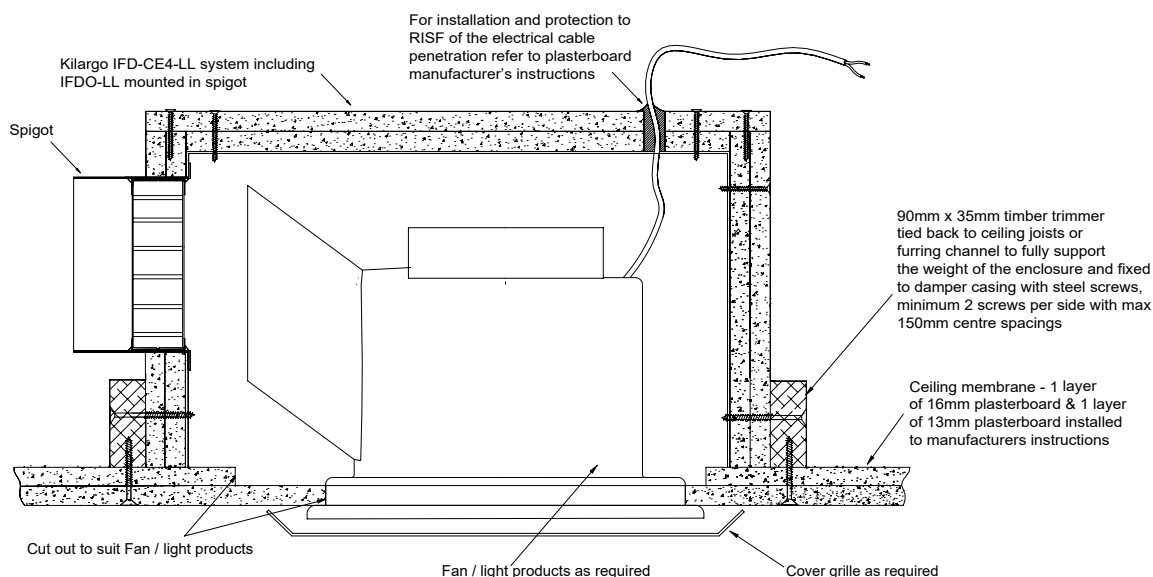


Installation Instructions:*Ceiling Under Floor & Ceiling Under Roof Systems*

- | | |
|---------------|--|
| Step 1 | If ceiling is in framing stage, start at step 2 below. For existing fire rated ceilings, mark and cut out to suit fan / light dimensions. |
| Step 2 | Fix timber trimmers to ceiling joists to fully support weight of system as per system drawing. |
| Step 3 | Install fan / light to ceiling cut out. |
| Step 4 | Fix IFD-CE4-LL box to framing as per system drawing ensuring fan's supply / exhaust location is the same side as the IFD-CE4-LL spigot. |
| Step 5 | Drill electrical cable hole in top of IFD-CE4-LL box and install as per ceiling plasterboard manufacturer's instructions to maintain ceilings RISF rating. |
| Step 6 | Fit cover grille as required. |
| Step 7 | Ensure convenient access is provided for visual inspection and cleaning as necessary. |
| Step 8 | Ensure product and certification labels are in a prominent position for easy identification during subsequent maintenance routines. |

System Notes

- Trimmers, fan / light unit, cover grille and fixings are to be supplied by others.
- Kilargo Intumescent Fire Dampers shall be installed in accordance with this detail and in accordance with the requirements of AS1682.2
- Ensure convenient access is provided for visual inspection and cleaning as necessary
- Where the RISF is different between the fire rated floor/ceiling or roof/ceiling and the Kilargo IFD-CE4-LL, the lower RISF shall apply to both.

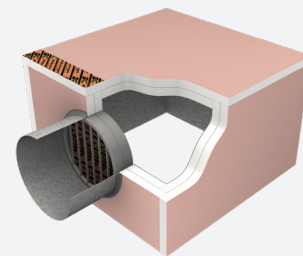

Building element:	1 x 13 & 16mm FR Plasterboard Ceiling
Application:	Ceiling Mounted Fire Rated Fan / light Enclosure (60 min RISF incipient rated)
Maximum size:	405 x 405
FRL	-/60/60
Test reference No.	FC16550

System No. CE4-60